



California ISO

WHITE PAPER

High Sustainable Limit (HSL)

October 14, 2020

Revision History

| Date | Version | Description | Author |
|------------|---------|---|----------------|
| 8/7/2020 | 1 | Initial posting of document | Jessica Taheri |
| 10/14/2020 | 1.1 | <ul style="list-style-type: none">• Minor wording changes• Answers to additional questions asked by Stakeholders in response to the August 10, 2020 Stakeholder call• Addition of HSL formula | Jessica Taheri |

Table of Contents

| | |
|--|-----------|
| BACKGROUND | 4 |
| HSL COMPARED TO CURRENT TELEMETRY | 5 |
| BUSINESS NEED | 7 |
| FORECASTING | 8 |
| ANCILLARY SERVICES | 10 |
| TECHNICAL SPECIFICATIONS..... | 12 |
| HOW HSL IS DETERMINED | 12 |
| RESOURCE UPDATES TO PROVIDE HSL..... | 12 |
| REPORTING HSL TO THE CAISO..... | 12 |
| STAKEHOLDER QUESTIONS | 13 |
| HSL VERSUS OTHER POINTS | 13 |
| <i>Dynamic Limit</i> | 13 |
| <i>Aggregate Capability Constraint</i> | 13 |
| OVERBUILT RESOURCES | 13 |
| LEGACY VER RESOURCES | 14 |
| DAY-AHEAD VERSUS REAL-TIME FORECASTING WITH HSL..... | 15 |
| HSL ACCURACY..... | 15 |
| HSL CALCULATION | 16 |

Background

As of August 1, 2020, there are over 19,700 MW of grid-connected variable energy resources (VERs) on the CAISO system.¹ Accurately forecasting the output of these VERs is increasingly critical to grid operations. Currently, the CAISO requires each resource to provide real-time telemetry and meteorological station information to create the highest quality forecast.² As market participants add batteries to these variable resources (under either a Hybrid or Co-Located configuration), having visibility to the VER components' production capability based on fuel availability during all intervals of the day will become more crucial to allow these resources to offer Ancillary Services (AS) and ensure the CAISO is able to provide the most accurate forecast possible under these new configurations. Given this need, the CAISO is proposing that the variable energy components of Hybrid and Co-Located Resources provide their High Sustainable Limit (HSL) as a telemetered value to the CAISO.³

The below three terms will be used throughout the White Paper and additional details can be found in the Revised Draft Tariff Language of the Hybrid Resources Initiative, but are repeated below:⁴

Hybrid Resource: A Generating Unit, with a unique Resource ID at a single Point of Interconnection, with components that use different fuel sources or technologies

Co-Located Resource: A Generating Unit with a unique Resource ID that is part of a Generating Facility with other Generating Units. An EIM Participating Resource with a unique Resource ID that is part of a single resource with other EIM Participating Resources.

The CAISO proposes to define High Sustainable Limit as follows:

High Sustainable Limit (HSL): The instantaneous generating capability of a variable or intermittent Generating Unit or component thereof, updated through telemetry at the Generating Unit. The High Sustainable Limit may not exceed the Generating Unit's PMax.

The HSL is a real-time estimate of the maximum output capability of a VER resource or the VER component of a Hybrid or Co-Located resource based solely on the resource's physical properties (*i.e.* number of solar panels or wind turbines, and available inverters) and the fuel available to the resource based on current weather conditions. The HSL will be sent to the CAISO as a calculated, telemetered value and represents the approximate energy output capability of the resource at that moment in time. It is a calculated estimate; not a forecast. For instance, a resource's HSL sent as a telemetry to the CAISO

¹ <http://www.caiso.com/informed/Pages/CleanGrid/default.aspx>

² See Appendix Q of the CAISO Tariff for specific requirements

³ The HSL was first identified as a need for Hybrid and Co-Located VERs in the Straw Proposal for the Hybrid Resources Initiative issued on October 3, 2019. In this Straw Proposal, it was first identified as "Plant Potential" but was updated to be referred to as the "High Sustainable Limit" in the Revised Straw Proposal issued on December 17, 2019.

⁴ <http://www.caiso.com/InitiativeDocuments/RevisedDraftTariffLanguage-HybridResourcesPhase1.docx>

at 10:00 PPT represents that resource's High Sustainable Limit at 10:00 PPT; it is not a forecast of the resource's capability at a future point in time.

The Electric Reliability Coordinator of Texas (ERCOT) has a similar value they require for all of their generation resources, called the High Sustained Limit. ERCOT defines the High Sustained Limit for a Generation Resource as

The limit established by the QSE [Qualified Scheduling Entity], continuously updated in Real-Time, that describes the maximum sustained energy production capability of the Resource⁵

and continue on in their Nodal Protocols (similar to CAISO's BPM)

For each Intermittent Renewable Resource (IRR), the QSE shall set the HSL [High Sustained Limit] equal to the current net output capability of the facility. The net output capability should consider the net real power of the IRR generation equipment, IRR generation equipment availability, weather conditions, and whether the IRR net output is being affected by compliance with a SCED [Security Constrained Economic Dispatch] Dispatch Instruction.⁶

The definition proposed by CAISO and the definition currently in effect in ERCOT's market are very similar. Both indicate that they are continuously updated in real time and express the physical generating capability of the resource at that time. Within ERCOT, the High Sustained Limit is considered a telemetry point and is a required input into their real-time sequence.⁷

At this time, the CAISO proposes that the HSL be required for Co-Located Resources and Hybrid Resources with a VER component. In the future, as VER resources are further offered and optimized in the market for Ancillary Services, including regulation, and supplemental dispatch, the CAISO anticipates that HSL will be required from VER resources. Discussions regarding requiring the HSL from VER resources (other than Hybrid or Co-Located) will be done in a future Stakeholder Initiative. When the CAISO implements tariff provisions requiring VERs to provide their HSLs, the CAISO plans to exempt all generators and interconnection customers that already have executed generator interconnection agreements. Interconnection customers with VERs that have yet to execute generator interconnection agreements when the requirement becomes effective will be required to provide their HSLs.

HSL Compared to Current Telemetry

The HSL is different than the current MW telemetry provided to the CAISO by current VER resources. For current VER resources, the MW telemetry value reflects actual supplemental dispatches, operating instructions, ancillary services and when applicable, losses. For Hybrid resources, the MW telemetry will also be impacted by the battery charging and discharging. Again, the HSL is not impacted by any market actions listed above, including battery charging or discharging, since it is simply an estimate of the VERs physical capability given fuel availability and current weather conditions. The HSL will allow the CAISO to

⁵ <http://www.ercot.com/glossary/h>

⁶ http://www.ercot.com/content/wcm/current_guides/53528/06-070120_Nodal.docx

⁷ http://www.ercot.com/content/wcm/current_guides/53528/06-070120_Nodal.docx

get a full picture of the maximum available output a VER resource or the VER component of a resource given current properties and weather conditions.

Figure 1 shows the difference in a solar resources MW telemetry currently provided to the CAISO, and the HSL on a day with heavy supplemental dispatch. The current MW telemetry (red line in Figure 1) is reflective of the current dispatch instructions from the ISO. The HSL value (blue line) is not impacted by the changes in the resources output due to supplemental dispatch values, nor would it be impacted by charging or discharging a battery, only changes in the fuel availability, *i.e.* weather.

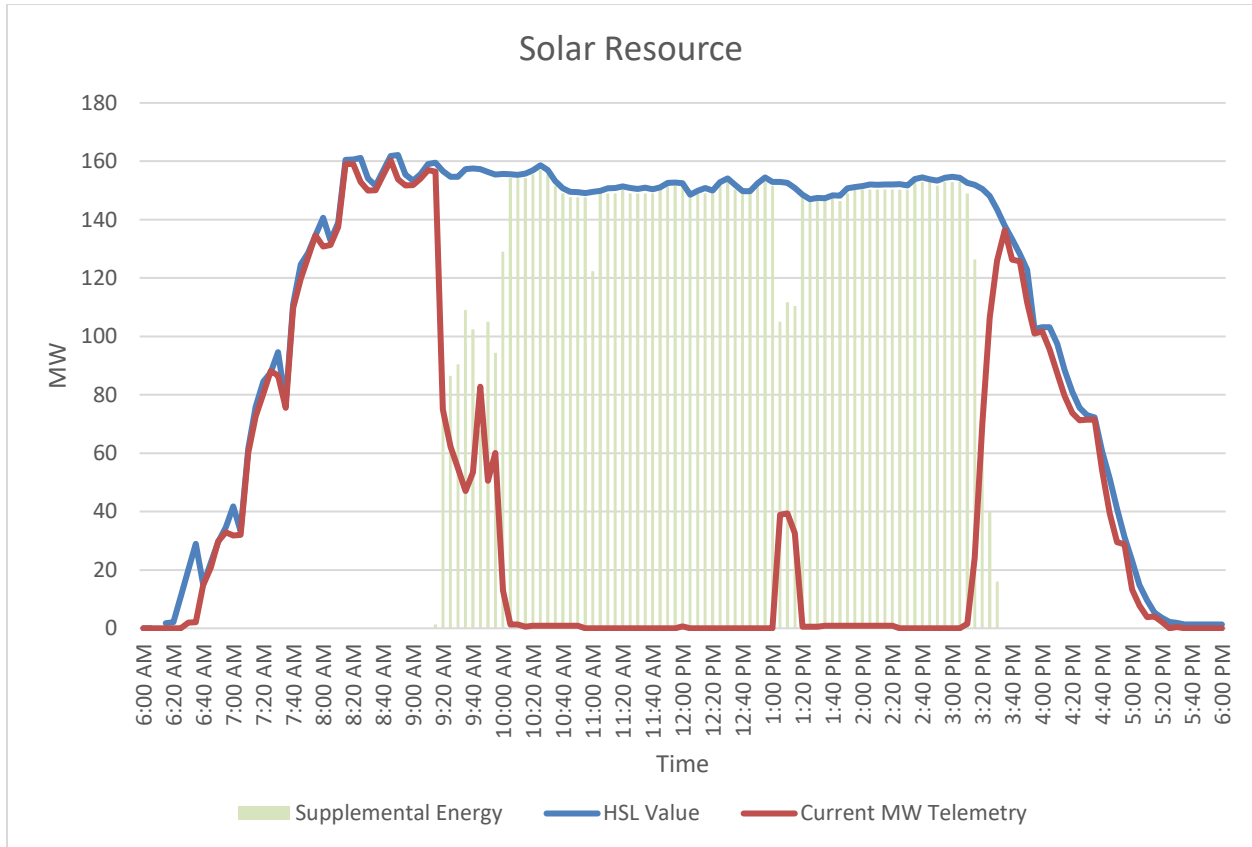


Figure 1: Comparing the HSL value to the current telemetry value received by the ISO for a solar resource during daylight hours.

Currently, with only the MW telemetry data provided to the CAISO by the VER resources, there could be a large amount of intervals where these values are impacted by supplemental dispatch and cannot be used in forecast creation. In current processes, the periods where supplemental dispatch is present for a resource, the telemetry is not used to create the real-time forecast. The CAISO can theoretically add supplemental dispatch back into the MW telemetry information to get an approximation of the resources production capability; however, the value calculated may be inaccurate, especially as the duration of supplemental dispatch is longer. This is shown in Figure 2 which compares the HSL value to the current MW telemetry plus supplemental dispatch (purple line). This estimate of capability would may be further confounded if the VER is not following dispatch instructions exactly. In addition, for periods where the resource is under an Operating Instruction or the MW telemetry is impacted by the battery charging/discharging, adding the supplemental dispatch data to the MW telemetry would not

give a full picture of the resources true production capabilities under the current weather conditions, as the HSL would.

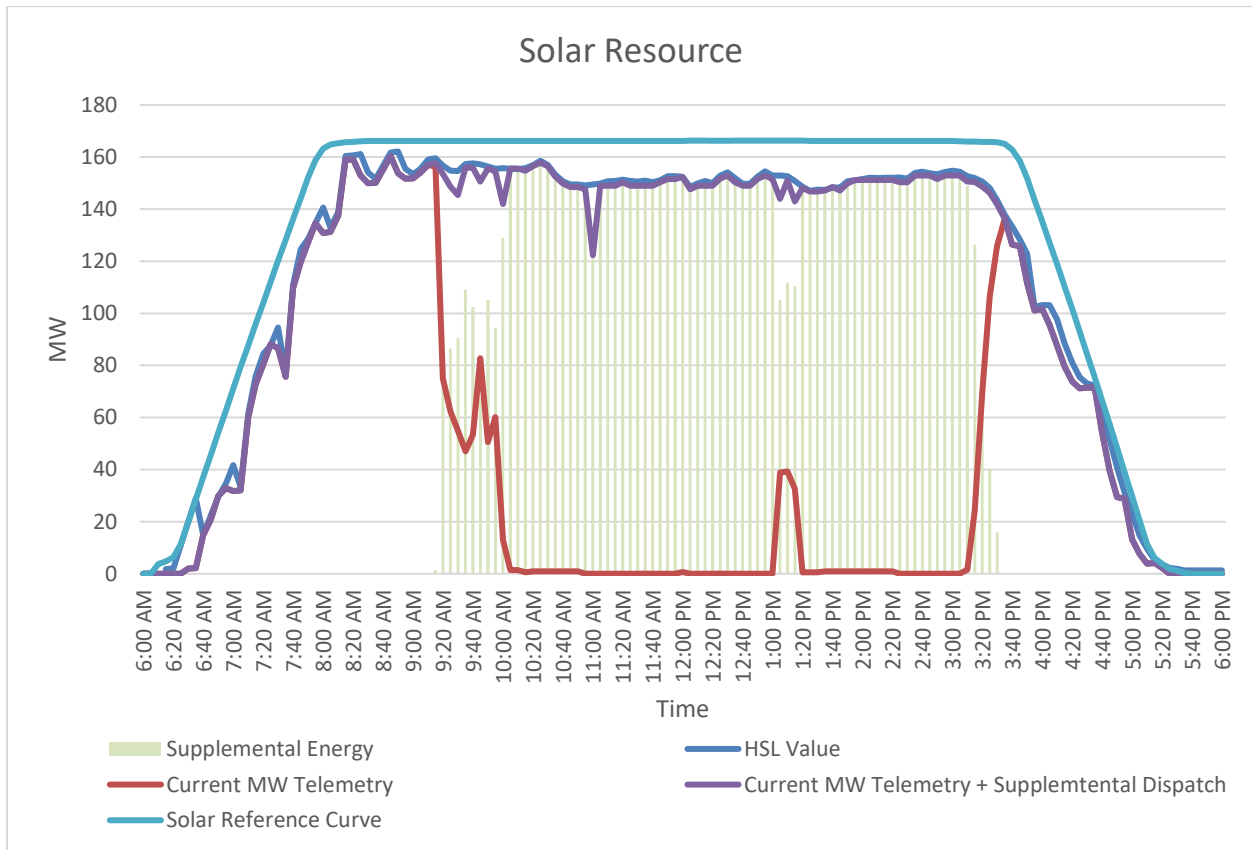


Figure 2: Comparing the HSL value, to the current MW telemetry the ISO receives, the solar reference curve and the current MW telemetry + supplemental dispatch. The purpose of adding supplemental dispatch into the current MW telemetry is described below.

Conversely, the HSL information for this day in Figure 2 provides a more informed capability of the resource and could have been used to inform the real-time forecasts. The HSL telemetry will be available for the CAISO’s forecast providers in real-time to use in their forecast creation. This will lead to a more accurate representation of what the resource could be producing feeding into the model. Additional information on this is below in the Business Needs section.

Figure 2 also includes the resources’ solar reference curve (light blue line), showing the maximum generation capability for this resource on this given day of the year given the sun angle and length of day. The solar reference curve does not take into account current weather conditions.

Business Need

The HSL telemetry will be primarily used for forecasting needs, but is also going to be indirectly used to assist with renewable resources that are providing AS, including regulation, in addition to assessing the capability of a Hybrid Resource and for operational awareness.

Forecasting

From the forecasting perspective, the HSL data will be sent to forecast providers to supply them with the generating capability of the VER component of a resource. Currently, when the MW telemetry is impacted by supplemental dispatch or operating instructions, this data cannot be used to create the real-time forecast. Instead, vendors must rely only on the meteorological station information and/or characteristics of the resource, *i.e.* location and panel characteristics for solar or turbine information for wind. The HSL data will allow the real-time forecast to continue to have an approximate weather-based MW capability as an input during periods of battery charging/discharging, supplemental dispatch, AS or operating instructions, instead of having to ignore the MW telemetry, like is currently done. In addition to improving the real-time forecast methodologies, the CAISO anticipates the use of HSL will improve the fifteen minute market (FMM) and day-ahead (DA) forecasts as well, due to a significant increase the amount of good data to use in the forecast training for all forecast horizons.

As described in the previous section, for periods of supplemental dispatch, the CAISO and forecast vendors can add the supplemental dispatch information to the MW telemetry to get an estimate of the resources total capability, but this is not always accurate. By providing the HSL to the CAISO's forecast vendors, the forecast creation can use the HSL for every interval of the day regardless of whether or not there is any market dispatch present, to better inform the forecast.

The HSL telemetry could also be used as an input to the Persistence forecast.⁸ The Persistence forecast is internal to the CAISO and heavily weights the MW telemetry from a VER resource to create the forecast used in real-time dispatch (RTD). Currently, the Persistence method uses the MW telemetry data coming from the resource as input. When this MW telemetry is impacted by a market dispatch (such as supplemental dispatch), then the external forecast is used for those intervals instead due to the MW telemetry no longer being reflective of the resources full production capability. It has been shown that the Persistence methodology has up to a 45% improvement on RTD forecast accuracy over the external forecast provider.⁹ In the future, the CAISO is hoping to use the HSL information as an input to the Persistence forecast. This will allow for the Persistence forecast to be used for all RTD intervals, regardless of battery or market impacts for a VER resource or VER component of a Hybrid or Co-Located resource.

Figure 3 below compares forecast creation methodologies with and without the HSL as forecast input on a day with an Operating Instruction (OI) for a wind resource. The OI was in place from 0800-1700 (0900 – 1800 on the graph below) and during this period this wind resource was instructed not to exceed the dispatch operating target (DOT). For this resource, the DOT was equal to the forecast as there was no supplemental dispatch present. The “Current Forecast” (red line) below is created using the external forecast for the RTD intervals during the day. The “Persistence Forecast Created Using HSL” (blue line) uses the HSL value at each interval as input to create the Persistence Forecast instead of the MW telemetry, as is currently done.

⁸ <http://www.caiso.com/Documents/Presentation-MarketPerformance-PlanningForum-Oct242018.pdf>

⁹ http://www.caiso.com/Documents/AgendaPresentation-MarketPerformancePlanningForum-Jun11_2018.pdf

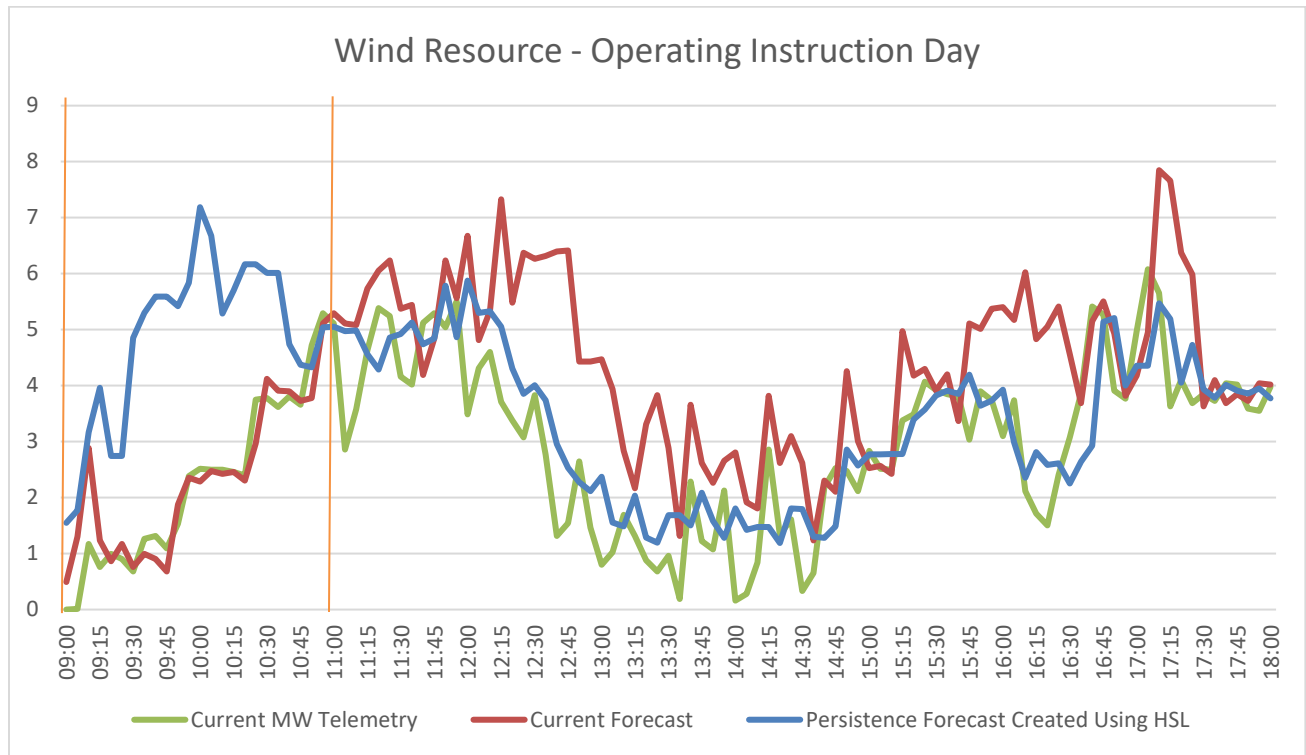


Figure 3: Comparing a wind resources forecast using current methodologies to the forecast created using HSL data on a day with an Operating Instruction

For the duration of the OI, the resource’s MW telemetry cannot exceed the RTD forecast (DOT). During the period of 09:00-11:00 (vertical orange lines), the MW telemetry is restricted to be less than the forecast. This figure shows that the HSL, and thus the actual capability of this resource, was significantly higher than the current RTD forecast. This is because the HSL telemetry and any persistence model based on these values would not be impacted by OI, only by the current weather conditions.

For the period of 11:00-18:00 in Figure 3, again the MW telemetry cannot exceed the forecast; however, in this instance the forecast is consistently too high, leading to increased forecast error. Comparing the two forecasts methodologies to the MW telemetry coming from the resource, the Persistence forecast created using the HSL is closer to the output of the resource, whereas the current forecast created using the external provider was consistently too high. Using the HSL as input to the Persistence forecast on this day would have led to 50% increased forecast accuracy during the entire OI and a 65% improvement in the forecast from 11:00-18:00.

The ISO would benefit from receiving the HSL and including it in the Persistence forecast during periods where there is an issue with the MW telemetry values received from a VER. Figure 4 below shows the Persistence forecast created using the current methodology of using the MW telemetry, which was in error, and the Persistence forecast created using the HSL telemetry as input. The CAISO does have checks to remove the Persistence method in RTD if the entire remote intelligent gateway (RIG) is down;

however if only the MW telemetry point is down, like below, then it’s possible the MW telemetry value experiencing an error is used to create the Persistence forecast in RTD.

In the current RTD forecast methodology, the real-time telemetry received by the ISO is a large statistical driver in creating the current real-time forecast for renewable resources. Potentially, the HSL can be used as the primary forecast input to Persistence for all resources across all days. In this type of situation with a telemetry error, using the HSL as input to the Persistence (RTD) forecast would have led to a higher forecast value, likely more representative of what the resource would have been able to produce given weather conditions. The opposite is also true if the HSL telemetry point goes down but the MW telemetry point is not in error and there are no market dispatches, then the MW telemetry could be used to create the RTD forecast as a back-up to the HSL.

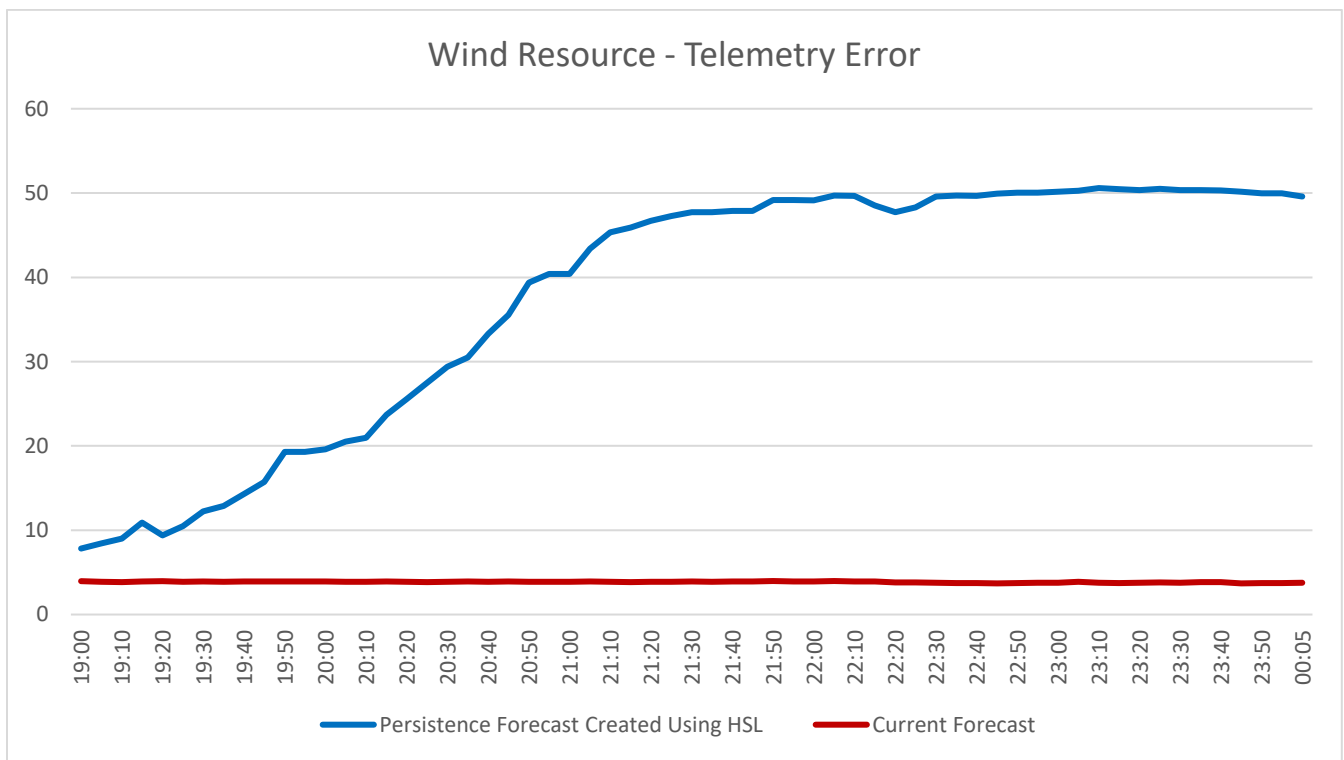


Figure 4: Comparing a wind resources forecasting using the current Persistence forecast methodology and using the Persistence forecast fed by the HSL data during a period of data quality issues.

Ancillary Services

Ancillary Services (AS) refers to Regulation¹⁰, Spinning Reserve, Non-Spinning Reserve, and Voltage Support with such other interconnected operation services as the CAISO may develop in cooperation

¹⁰ The service provided either by resources certified by the CAISO as equipped and capable of responding to the CAISO's direct digital control signals, or by System Resources that have been certified by the CAISO as capable of delivering such service to the CAISO Balancing Authority Area, in an upward and downward direction to match, on a Real-Time basis, Demand and resources, consistent with established NERC and WECC reliability standards and

with Market Participants to support the transmission of Energy from Generation resources to Loads while maintaining reliable operation of the CAISO Controlled Grid.¹¹

In the current CAISO system there is no way to send AS information for VER resources when they are being dispatched for AS, including regulation, to our forecast providers. This implies that forecast providers do not have necessary information to create a fully informed VER forecast because information including AS awards and dispatches is missing. The CAISO would also have to send regulation up cleared, regulation up dispatched, regulation down cleared and regulation down dispatched, in addition to telemetry and supplemental dispatch information already sent.¹² This information would need to be transmitted every 5-minutes for every VER, increasing the amount of data sent to vendor and the amount of time and processing power include this information into the forecast. This would likely add additional lag time between the forecast providers receiving data as inputs and when the market forecast is generated and sent to participants and the CAISO.

See Table 1 below for an example of how the current MW telemetry and HSL would be impacted by an AS award.

These modelling issues could be resolved if a single HSL data point was provided, instead of each AS data point. This will allow there to be good data for all intervals, regardless of the AS award or dispatch and will allow for improved forecasting methodologies as a result. The CAISO expects the number of VER resources providing AS, as well as the number of intervals each resource provides AS to increase in the coming years, especially with batteries attached, and by providing the HSL to our vendors, this will limit the amount of data impacted by AS awards and dispatches.

| Data Point (MW) | Hour 12 | Hour 13 | Hour 14 |
|-----------------------------|----------------|----------------|----------------|
| Forecast | 500 | 500 | 500 |
| AS Regulation Up Cleared | 100 | 100 | 100 |
| DOT | 400 | 450 | 500 |
| MW Telemetry | 400 | 450 | 500 |
| AS Regulation Up Dispatched | -- | 50 | 100 |
| HSL | 500 | 500 | 500 |

Table 1: How the MW telemetry and HSL will be impacted by AS awards. AS Regulation Up Cleared and AS Regulation Up Dispatched are additional points The CAISO would need to provide to forecast providers to obtain the same information that HSL could supply in one point.

In addition, by receiving the HSL data the CAISO is able to confirm that the VER resource is able to produce any necessary energy when an AS award is given.

any requirements of the NRC. Regulation includes both an increase in Energy production by a resource or decrease in Energy consumption by a resource (Regulation Up) and a decrease in Energy production by a resource or increase in Energy consumption by a resource (Regulation Down).

¹¹ <http://www.caiso.com/Documents/AppendixA-MasterDefinitionSupplement-Jul1-2020.pdf>

¹² See Appendix A of the CAISO Tariff for definitions of Regulation Up and Regulation Down

Technical Specifications

How HSL is Determined

HSL is a calculated value that comes directly from the site. When there is no supplemental dispatch or AS in place, the HSL is the generation capacity. When there is supplemental dispatch in place, the HSL is the generation capacity without the supplemental dispatch or AS signal. The generation capacity is calculated based upon known weather information and characteristics of the resource, such as: wind speed, wind direction and number of turbines for wind resources, and solar irradiance and available inverters from a solar resource. This information can be applied to a known power curve for the site to determine the sites generation capacity.

The CAISO is proposing that the following calculations be used to determine HSL. By having one consistent formula across each resources by type, this will create uniformity in data the resources are providing.

*Wind: Site Output * number of turbines available – electrical losses*

*Solar: Site Output * number of inverters available – electrical losses*

Where *Site Output* refers to a solar sites average irradiance or a wind sites average wind speed put through the individual sites power curve to obtain the output in MW.

Resource Updates to Provide HSL

As long as the site has an existing telemetry point communicating with the CAISO, the only potential enhancements to the site would be on the software side. In discussions with renewable builders, it was communicated to the CAISO that the cost would be minimal to provide the HSL information as it does not require installation of new equipment.

Reporting HSL to the CAISO

HSL will be reported in the same manner as current MW telemetry and meteorological station information is reported. The CAISO would like the HSL information transmitted as quickly as possible to minimize the amount of lag in forecast processes. It has been shown that HSL can be sent as frequent as 10-seconds. The CAISO is proposing the HSL be sent at a 10-second frequency. Each VER component of a Hybrid Resource must provide their own HSL value, just as they will be expected to provide their own MW telemetry and meteorological information. The resource owners SCADA team would need to collaborate with the CAISO to add HSL as a data point coming from the resource.

Stakeholder Questions

The majority of questions asked in response to the Hybrid Resource Initiative Stakeholder Meeting and Second Revised Draft Proposal have been answered in previous sections.¹³ There were additional questions that we wanted to provide answers for, which are below.

HSL versus Other Points

What is the difference in meaning and calculation between HSL, dynamic limit and aggregate capability constraint?

Dynamic Limit

The CAISO is developing a tool for Hybrid Resources that will limit the amount that the resource may be dispatched to base values submitted to the ISO from the scheduling coordinator (SC), which is called the dynamic limit tool. The CAISO is requiring that resources that SCs use this tool submit information in the RTD market that captures output restrictions from the resource including limitations from variable components and state of charge for storage components of the hybrid resource. These values will limit the dispatch instruction for the Hybrid Resource in the positive or negative direction. The dynamic limit value will be based off the total output expected by the Hybrid Resource, whereas the HSL value is the maximum output of only the VER component of the Hybrid Resource. The HSL is a telemetry used to inform the forecast sent to the SC to create their forecast for the full Hybrid Resource, as it itself is not a forecast.

For current, stand-alone VER resources, the CAISO derives an upper dynamic limit strictly from the forecast generation.

Aggregate Capacity Constraint

Using the aggregate capacity constraint functionality, the CAISO will have the ability to issue market awards and dispatches from co-located resources to ensure the combined output of co-located resources associated with a single generating facility does not exceed the interconnection service capacity of that generating facility. Interconnection customers electing to use the aggregate capacity constraint will allow co-located resources to register their maximum operating limit as their PMax, even if the aggregate values of these maximum operating limits are greater than interconnection rights set forth in their generating facility's generator interconnection agreements.

The HSL is not the amount of energy the VER resource is actually putting onto the grid, rather it is the maximum generating capacity of the VER resource. It is possible for this maximum generating capacity to be higher than the interconnection service capacity at the point of interconnection (POI) if the VER resources PMax is higher than the POI (see Overbuilt Resources below for additional details). HSL is a telemetry point from the VER resource sent to the CAISO to inform the forecast.

Overbuilt Resources

How would an overbuilt resource (build in excess of the POI limit to charge the storage) report its HSL?

¹³ <https://stakeholdercenter.caiso.com/StakeholderInitiatives/Hybrid-resources>

An overbuilt resource refers to a resource that have built more MW than they were studied for in the generator interconnection process as the Net MW at the POI. These resources are either a Hybrid Resource or Co-Located Resource, who’s solar or wind component was built with additional generation capacity such that the VER is capable of generating more energy than the POI limit provided to the CAISO. For example, a resource with a 150 MW solar component and a 50 MW battery, but the Net MW at the POI is 100 MW. A resource may do this to use the additional 50 MW of solar production to charge the battery on a sunny day or to have additional MW to assist in providing the full 100 MW capability on a cloudy day without having to lean on the battery.

For these cases, the HSL would be reported as the maximum amount of generation that the VER resource would be able to produce without the POI limitation. Meaning if the generating capability of a solar resource is 150 MW and the Net MW at the POI is 100 MW, the HSL would be 150 MW as this is what the VER component is able to produce. For Hybrid resources, the forecast sent to the SC will be for the full renewable component. The below tables provide examples of how the HSL would be reported for a 150 MW solar resource with a 50 MW battery and a 100 MW POI.

| Solar (MW) | Battery Charging (MW) | Net at POI (MW) | HSL (MW) |
|------------|-----------------------|-----------------|----------|
| 150 | 50 | 100 | 150 |

| Solar (MW) | Battery Charging (MW) | Net at POI (MW) | HSL (MW) |
|------------|-----------------------|-----------------|----------|
| 120 | 50 | 70 | 120 |

Table 2: Showing the HSL value reported to the ISO for an overbuilt Hybrid resource.

Legacy VER resources

How will the CAISO deal with the HSL and legacy wind turbines or solar resources?

When the CAISO implements tariff provisions requiring hybrid and co-located VERs to provide their HSLs, the CAISO plans to exempt all generators and interconnection customers that already have executed generator interconnection agreements. Interconnection customers with VERs that have yet to execute generator interconnection agreements when the requirement becomes effective will be required to provide their HSLs.

As long as the site has an existing telemetry feed to the CAISO, interconnection customers can elect to add HSL, regardless of whether they are required to do so. The information required for legacy resources to calculate the HSL is the same as described above in the “How is the HSL determined” section and includes: total site MW generation, wind speed and number of turbines online if a wind site and solar irradiance and number of inverters available if solar. As mentioned above, discussions regarding requiring the HSL from VER resources other than Hybrid or Co-Located, including legacy VERs, will be done in a future Stakeholder Initiative.

Day-Ahead versus Real-Time Forecasting with HSL

How does the day-ahead VER forecast differ from the real-time forecast in its usage of HSL?

The day-ahead (DA) VER forecast uses the weather forecast for the site of interest and historical MW production of the site under similar and recent weather conditions. As mentioned in the White Paper, current MW telemetry provided to the ISO is impacted by supplemental dispatch, Operating Instructions, a battery charging/discharging, and in the future will be impacted by AS dispatches and clearing of renewable resources. This affected data is not useable in the historical set of similar weather conditions to train the model. As long as the HSL telemetry is not in error, it will be useable at all instances and will significantly increase the number of good intervals available to train the model, thus improving the DA forecast.

The real-time (RT) VER forecast weights the recent RT MW telemetry of the site heaviest. It also utilizes the RT meteorological data provided by the resources and weather forecast information, but this is not weighted as heavy in the forecast when there is good quality MW telemetry available. Currently, when supplemental dispatch is present, the real-time forecast creation has to fall back on RT meteorological telemetry data and/or weather forecast information as the MW telemetry is not reflective of the sites true generation capability. In the future this would also be true if the resource was providing AS or a battery was charging/discharging. By having the HSL telemetry available, the RT forecast can be consistently formed using the sites weather-based production capability, instead of having to rely on the meteorological information for intervals when the resource is being used for AS or has battery impacts. In addition, like the day-ahead forecast, the real-time forecast will also benefit by having the HSL used in model training and will increase the number of intervals with good data to train the RT models for VERs. The *Forecasting* section above mentions accuracy improvements in the RTD forecast that are currently observed when good quality information on the sites generation capabilities are available.

HSL Accuracy

How will the CAISO ensure each resource's calculations of HSL are accurate?

During times of non-dispatch, the HSL will be very similar to the MW telemetry. The CAISO can compare these two values to ensure the HSL calculation is accurate. As an additional check, the HSL output can also be plotted against the irradiance or wind speed and direction and compared to the MW telemetry during times of non-dispatch at the same intervals to ensure the HSL value is reasonable given the weather conditions. Figure 5 below is an example of this for a wind resource using wind speed and the resources current MW telemetry and HSL and shows that for

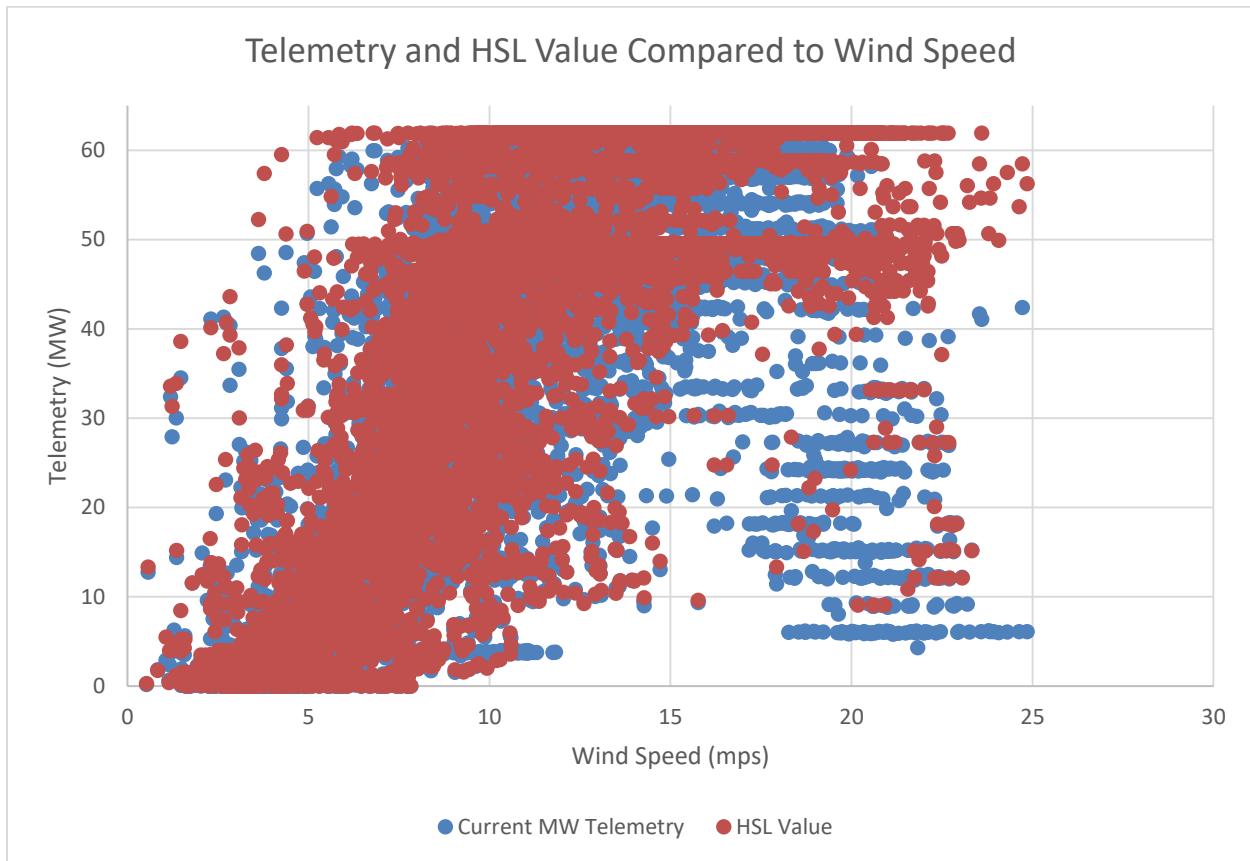


Figure 5: A scatter plot showing the relationship between wind speed (x-axis) and the HSL and MW telemetry. In this example, only the wind speed is plotted against the telemetry, but for a more detailed verification, wind speed and direction data can be combined and plotted against the telemetry values.

HSL Calculation

Why is the CAISO not able to incorporate HSL as part of its calculation?

The HSL is a calculation based on various weather and resource information, such as the wind speed and number of turbines for a wind resource or solar irradiance and available inverters for a solar resource. Information of the number of available turbines or inverters is not currently provided to the ISO. If these additional points were provided to CAISO by each resource in addition to the meteorological and telemetry data, it would add significant processing time for the CAISO and vendors to calculate the HSL value for each VER resource every 10 seconds. One of the benefits of receiving HSL as a telemetry is to get frequent 10-second updates, which would not be possible if the CAISO was doing the calculation.